

POLYGUARD PRODUCTS, INC. TEST REPORT

SCOPE OF WORK

ASTM B117 SALT FOG EVALUATION OF RG 2400 ET PRODUCT

REPORT NUMBER

J5985.03-106-31-R0

TEST DATES

04/29/19 - 06/11/19

ISSUE DATE

07/11/19

RECORD RETENTION END DATE

06/11/23

PAGES


7

DOCUMENT CONTROL NUMBER

ATI 00231 (09/05/17)

RT-R-AMER-Test-2827

© 2017 INTERTEK

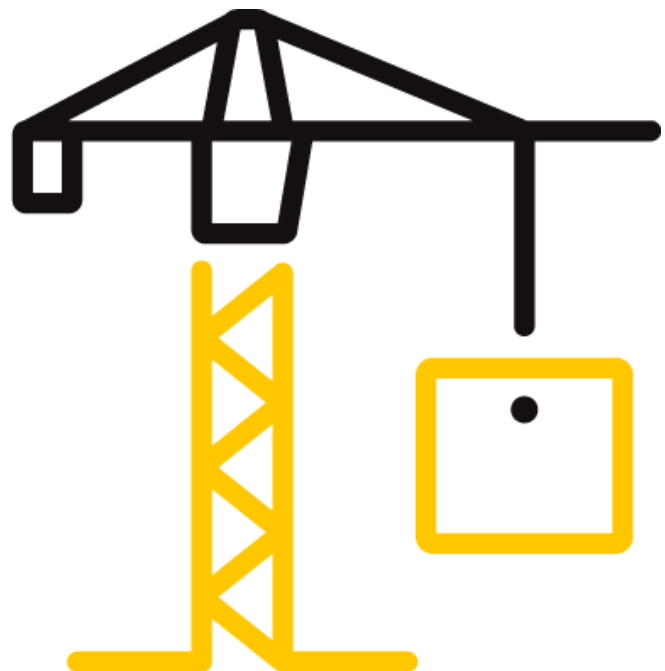

TEST REPORT FOR POLYGUARD PRODUCTS, INC.

Report No.: J5985.03-106-31-R0

Date: 07/11/19

REPORT ISSUED TO

POLYGUARD PRODUCTS, INC.

1901 US Hwy 287

Corsicana, Texas 75110

SECTION 1


SCOPE


Product: RG 2400 AK

Intertek Building & Construction (B&C) was contracted by Polyguard Products, Inc., to evaluate RG 2400 ET in accordance with ASTM B117 for Salt Fog Exposure. Results obtained are tested values and were secured by using the designated test method. Testing was conducted at the Intertek B&C test facility in York, Pennsylvania.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

For INTERTEK B&C:

COMPLETED BY:	Ronald J. Gover Jr.
TITLE:	Technician III Materials Laboratory
SIGNATURE:	 <small>Digitally Signed by: Ronald Gover</small>
DATE:	07/11/19

REVIEWED BY:	Joseph M. Brickner
TITLE:	Laboratory Manager Materials Laboratory
SIGNATURE:	 <small>Digitally Signed by: Joseph M. Brickner</small>
DATE:	07/11/19

RJG:jmb/als

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

TEST REPORT FOR POLYGUARD PRODUCTS, INC.

Report No.: J5985.03-106-31-R0

Date: 07/11/19

SECTION 2

TEST METHODS

The specimens were evaluated in accordance with the following:

ASTM B117-18, *Standard Practice for Operating Salt Spray (Fog) Apparatus*

SECTION 3

MATERIAL SOURCE

The materials were provided by Polyguard Products, Inc. The following was received on April 8, 2019: 1 can of RG 2400 ET. The material was tested as received. Representative materials/test specimens will be retained by Intertek B&C for a minimum of four years from the test completion date.

SECTION 4

LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Ronald J. Gover Jr.	Intertek B&C
Joseph M. Brickner	Intertek B&C

SECTION 5

TEST PROCEDURES

All conditioning of test specimens and test conditions were at standard laboratory conditions unless otherwise reported. Refer to the test related photos in Section 9.

ASTM B117 - Salt Fog

Samples were conditioned in the lab for a minimum of 48 hours. The sample was applied to clean steel panels at a 25-mil thickness. Test specimens were subjected to a 1,000-hour exposure in a QFOG salt fog cabinet (ICN: Y006716) utilizing a 5% (by weight) solution of reagent grade Sodium Chloride and laboratory grade water. The cabinet operated with a continuous fog at $35 \pm 3^{\circ}\text{C}$ and an atomized solution pH between 6.5-7.2. Specimens were supported at an angle between 15° and 30° from vertical. Specimens were removed at test completion for observations and to be photographed.

TEST REPORT FOR POLYGUARD PRODUCTS, INC.

Report No.: J5985.03-106-31-R0

Date: 07/11/19

SECTION 6

TEST SPECIMEN DESCRIPTIONS

TEST PROCEDURE	NUMBER OF SPECIMENS	NOMINAL SPECIMEN DIMENSIONS	VISUAL CHARACTERISTICS
ASTM B117	3	3in. by 5in. by 25mil.	Greyish Blue, Gel

SECTION 7

TEST RESULTS

ASTM B117 - Salt Spray Exposure - 1000 Hours of with X-Scribe

PRODUCT IDENTIFICATION	RESULT	GRADE
RG 2400 ET	1	The gel properties of the RG 2400 ET appeared to protect the CRS Panel. After the gel was removed the CRS panel showed no signs of corrosion.
	2	
	3	
		10-G

Reference Scale and Description of Rust Ratings - (Table 1 ASTM D610)

RUST GRADE	PERCENT OF SURFACE RUSTED	VISUAL EXAMPLES		
		SPOT (S)	GENERAL (G)	PINPOINT (P)
10	Less than or equal to 0.01%	None	None	None
9	Greater than 0.01% and up to 0.03%	9-S	9-G	9-P
8	Greater than 0.03% and up to 0.1%	8-S	8-G	8-P
7	Greater than 0.1% and up to 0.3%	7-S	7-G	7-P
6	Greater than 0.3% and up to 1.0%	6-S	6-G	6-P
5	Greater than 1.0% and up to 3.0%	5-S	5-G	5-P
4	Greater than 3.0% and up to 10.0%	4-S	4-G	4-P
3	Greater than 10.0% and up to 16.0%	3-S	3-G	3-P
2	Greater than 16.0% and up to 33.0%	2-S	2-G	2-P
1	Greater than 33.0% and up to 50.0%	1-S	1-G	1-P
0	Greater than 50.0%	None	None	None

SECTION 8

CONCLUSION

The requested test method does not contain specific performance requirements.

TEST REPORT FOR POLYGUARD PRODUCTS, INC.

Report No.: J5985.03-106-31-R0

Date: 07/11/19

SECTION 9 PHOTOGRAPHS

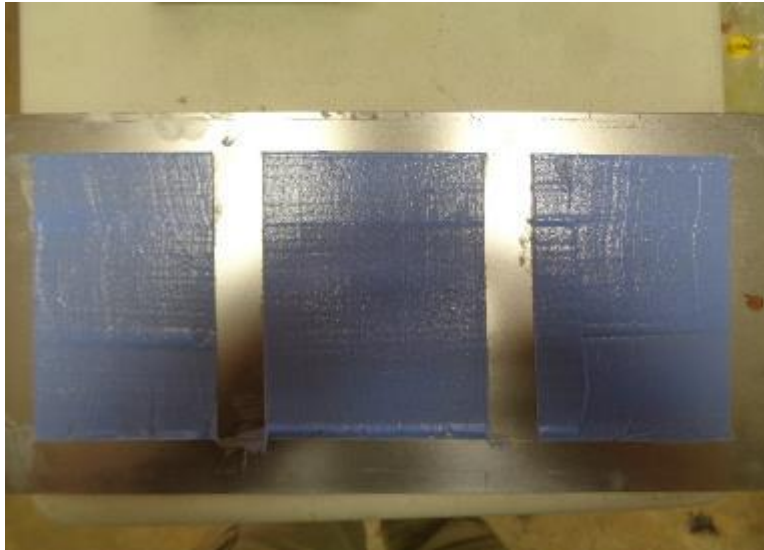


Photo No. 1
RG 2400 ET Pre Exposure



Photo No. 2
RG 2400 ET Post Exposure

TEST REPORT FOR POLYGUARD PRODUCTS, INC.

Report No.: J5985.03-106-31-R0

Date: 07/11/19



Photo No. 3
RG 2400 ET Clean



Total Quality. Assured.

130 Derry Court
York, Pennsylvania 17406

Telephone: 717-764-7700
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR POLYGUARD PRODUCTS, INC.

Report No.: J5985.03-106-31-R0

Date: 07/11/19

SECTION 10

REVISION LOG

REVISION #	DATE	PAGES	REVISION
0	07/11/19	N/A	Original Report Issue